



AN ROINN DEPARTMENT OF  
OIDEACHAIS EDUCATION  
AGUS EOLAÍOCHTA AND SCIENCE

*Planning & Building Unit*

***Information and Communication  
Technology (ICT)  
Infrastructure Guidelines  
For  
Primary Schools***

*Planning & Building Unit  
Building Section  
Department of  
Education and Science  
Tullamore, Co. Offaly.*

*Telephone: (0506) 24300  
Fax: (0506) 51119*

*Web:  
<http://www.education.ie>*

**TGD 004**

*First Edition  
February 2004*

## Table of Contents

<b>1.0 Introduction</b>	<b>3</b>
<b>2.0 Design Philosophy</b>	<b>4</b>
2.1 General Design Philosophy	4
2.2 Standards	4
2.3 ICT Design Philosophy	4
2.4 Structured Cabling Systems	5
2.5 Local Area Network (LAN)	7
<b>3.0 Communications Infrastructure</b>	<b>9</b>
3.1 Data Communications Centre (DCC)	9
3.2 Main Distribution Facility (MDF)	9
3.3 Intermediate Distribution Facility (IDF)	9
<b>4.0 Services Infrastructure</b>	<b>10</b>
4.1 Services to Primary Data Communications Equipment	10
4.2 Services to Teaching Spaces	11
4.3 General Structured Cabling Specification Requirements	12
4.4 General Specification Requirements	16
<b>5.0 Schedule of points</b>	<b>20</b>
<b>6.0 Documentation</b>	<b>20</b>
<b>7.0 Testing, Commissioning and Record Drawings</b>	<b>20</b>
<b>8.0 Training and Demonstration</b>	<b>21</b>
Appendix A Completion Record Sheet	22

## 1.0 Introduction

All Primary School projects encompassing Information and Communication Technology (ICT), including those that are at Stage 3 or Pre Stage 3 planning at the time of issue of this document, must comply with these guidelines when developing subsequent stages.

These guidelines relate to the integration of the infrastructure needs of Information and Communication Technology (ICT) with the building structure; they are for issue to school authorities (hereinafter referred to as the Client<sup>1</sup>) and to design teams and are intended for use in the design of new schools and extensions to existing schools. They are not intended to provide guidance on the management of ICT systems or software needs for schools. They replace all previously issued guidelines for ICT infrastructure in Primary schools.

The guidelines reflect recent changes in the educational system in Ireland and changes in ICT technology and standards, they are based on Engineering Applications that work and suit the school environment best and not just best engineering practices.

Where it is proposed to construct a new school these guidelines shall be applied in full. In the case of an extension project or refurbishment project, a flexible pragmatic approach shall be required, in these cases the Consultants shall identify any issues and agree a brief with the Planning and Building Unit prior to the commencement of design.

This document does not relieve the Building Services Consulting Engineers from their normal design responsibilities.

In applying these guidelines to projects, Schools, Clients and Design Team Consultants shall be obliged to comply in full with the Design Team Procedures and other guidance issued by the Department.

In all instances, the Department of Education & Science shall have the final say in the application of these Guidelines to projects where grant-aid is to be sanctioned.

For further advice on these or any other matter, please contact:

The Planning & Building Unit  
Building Section  
Department of Education & Science  
Portlaoise Road,  
Tullamore,  
County Offaly.

Telephone: 0506 24300 Fax: 0506 51119 Web: <http://www.education.ie>

---

<sup>1</sup> In the case of some Primary Schools the Minister for Education and Science is the Client, but for the purposes of this document the term “Client” shall also encompass the School Authorities.

## **2.0 Design Philosophy**

### **2.1 General Design Philosophy**

The different functions of the Design Team members shall be integrated, combining Building Services Engineering, Architectural Design, Structural Engineering and Quantity Surveying to create a well designed, sustainable, cost effective, durable low maintenance building.

The design shall allow repair or replacement of components of the building such as fittings, finishes and services with minimum disruption and cost. To achieve this it is essential that all disciplines within the Design Team work together from the beginning of the project and that the design is developed through collaboration by all the Design Team members.

The Building Services Consulting Engineer shall ensure that all potential costs that could arise during the execution of the contract and the installation and commissioning of the ICT Infrastructure to schools are provided for inclusion at the appropriate stage and in the appropriate manner, this also includes possible capital contributions for Internet access.

The Capital contribution for supply and connection shall be included in the project cost but not in the tender documents.

In the case of a school extension where an ICT system is to serve both the extension and the existing building, the cost shall be apportioned between new and existing on the basis of floor area. The portion of cost applicable to the extension is included in the basic building cost of the extension and the portion of cost applicable to the existing building is included in abnormal costs.

### **2.2 Standards**

The International Standard for Generic Cabling Systems is ISO11801: 2002. All references to this standard, in this document, refer to this version.

Where possible, International Organization for Standardization (ISO standards) are used in this document. Where two sets of standards exist with similar characteristics, it is expected that the ISO standard shall be applied.

Standards noted are current at time of writing; the prevailing versions of these standards shall be used at time of design and installation.

### **2.3 ICT Design Philosophy**

All teaching and habitable rooms shall be networked. Each of these rooms shall have network points in accordance with the schedule in section 5 and shall be networked through a local switch, the Intermediate Distribution Facilities (IDF) if applicable, or the Main Distribution Facility (MDF) which is located in the

Data Communication Centre (DCC) whichever is the most economical. Other non-teaching Spaces as scheduled shall be provided with a network point. A description of the above facilities is included in section 4.1.

The locations of the computer area in each teaching space in existing schools shall be agreed with the Client prior to design, positions of network points in new schools shall be as indicated on the standard room layout drawings. Multiple points shall be positioned in the one area of the classroom.

The position of network points in all offices shall be agreed with the school prior to design and co-ordinated with the furniture layouts.

A dedicated Data Communication Centre (DCC) shall be provided as detailed in section 3.

Internet access to schools shall be via either Analogue, ISDN, Broadband, Cable, Very Small Aperture Technology (VSAT) or Wireless services. The Building Services Consulting Engineers are required to report at Stage 2 on the various types of Internet access available in each situation. The intent shall be to provide the school with the fastest and most economical service available.

## **2.4 Structured Cabling Systems**

The primary network shall be designed as Category 5 enhanced / Class D to ISO 11801.

The network shall be Fast Ethernet standard IEEE802.3u with auto-sensing switches.

The specialising Building Services Consulting Engineer skilled in Local Area Networks (LAN) and Networking shall review the site and develop the cabling design.

The ICT infrastructure for a new school shall be addressed at Stage 2.

It is deemed appropriate that the structured cabling system be installed by suitably trained Electrical Contractors, or appropriately trained personnel; however, only specialist contractors shall be used to install fibre optic cabling.

Telephony shall not be part of the ICT structured cabling system. Refer to "*Mechanical & Electrical Building Services Engineering Guidelines For Primary schools*" for details of telephony requirements.

The infrastructure to be provided under the infrastructure-cabling contract shall include the structured cabling, RJ45 sockets, RJ45 patch panels and cabinets, these shall all be compatible and from the same manufacturer to ensure optimum performance.

The Client shall supply as part of the School equipment the router, servers and associated UPS, switches and patch leads in accordance with the Department's ICT Equipment Guidelines.

The following three scenarios represent the majority of Primary schools.

#### **2.4.1 *Single building within 90 metres.***

A school comprising one building where it is possible to reach each Primary Network point within 90 metres (actual cable run excluding patch leads) from the dedicated Data Communication Centre (DDC), which will house the Main Distribution Facility (MDF).

#### **2.4.2 *Single building not within 90 metres***

A school comprising one building where it is not possible to reach all network point within 90 metres (actual cable length excluding patch leads) from the dedicated Data Communication Centre which will house the Main distribution Facility.

A building of this type will require Intermediate Distribution Facilities (IDF) to interconnect the system. The connection between an IDF and the MDF within the same building shall be by Category 5e (enhanced) UTP cable when the distance involved is less than 90 metres. When this distance is greater a fibre optic backbone cable or a wireless connection whichever is the most economical and appropriate shall be considered for this aspect of the system, and a brief agreed with the Building Unit at Stage 2

#### **2.4.3 *Multiple buildings***

Where a school comprises two or more buildings there may be different solutions depending on the possibility to reach each network point within 90 metres (actual cable run) of the dedicated Data Communication Centre.

For the inter-connection between an IDF in a separate building and the MDF in the main building a multimode fibre optic backbone cable or a wireless connection whichever is the most economical and appropriate shall be considered for this aspect of the system, and a brief agreed with the Building Unit at Stage 2.

The cabling where practicable shall be over ground and carried in the links between the buildings. Where this is not possible a completely sealed duct shall be provided with all bends having a radius suitable for the fibre optic cable.

## **2.5 Local Area Network (LAN)**

In all circumstances the Network shall be Fast Ethernet based.

System Administration shall be part of the School's Network Management Procedures. It is envisaged that there shall be minimum levels of access to the school network to facilitate different user groups, i.e. Students, Teachers, and Administrators.

### **2.5.1 Wireless Ethernet.**


In some existing schools it may not be possible to install a complete cabling installation. These may include a listed building, an existing larger school with limited distribution zones or existing remote buildings.

In these cases wireless Ethernet may be considered as a component of an overall structured cabling infrastructure. This should be highlighted at Stage 2 and a brief agreed with the Building Unit.

Each application shall be viewed individually and agreed between the Client and the Building Services Consultant Engineer as to its appropriateness.

## 2.5.2 ICT Network Schematic

The following Network Schematic indicates the various options depending on the computer locations and their proximity to the MDF. The most economical and pragmatic solution shall be selected.

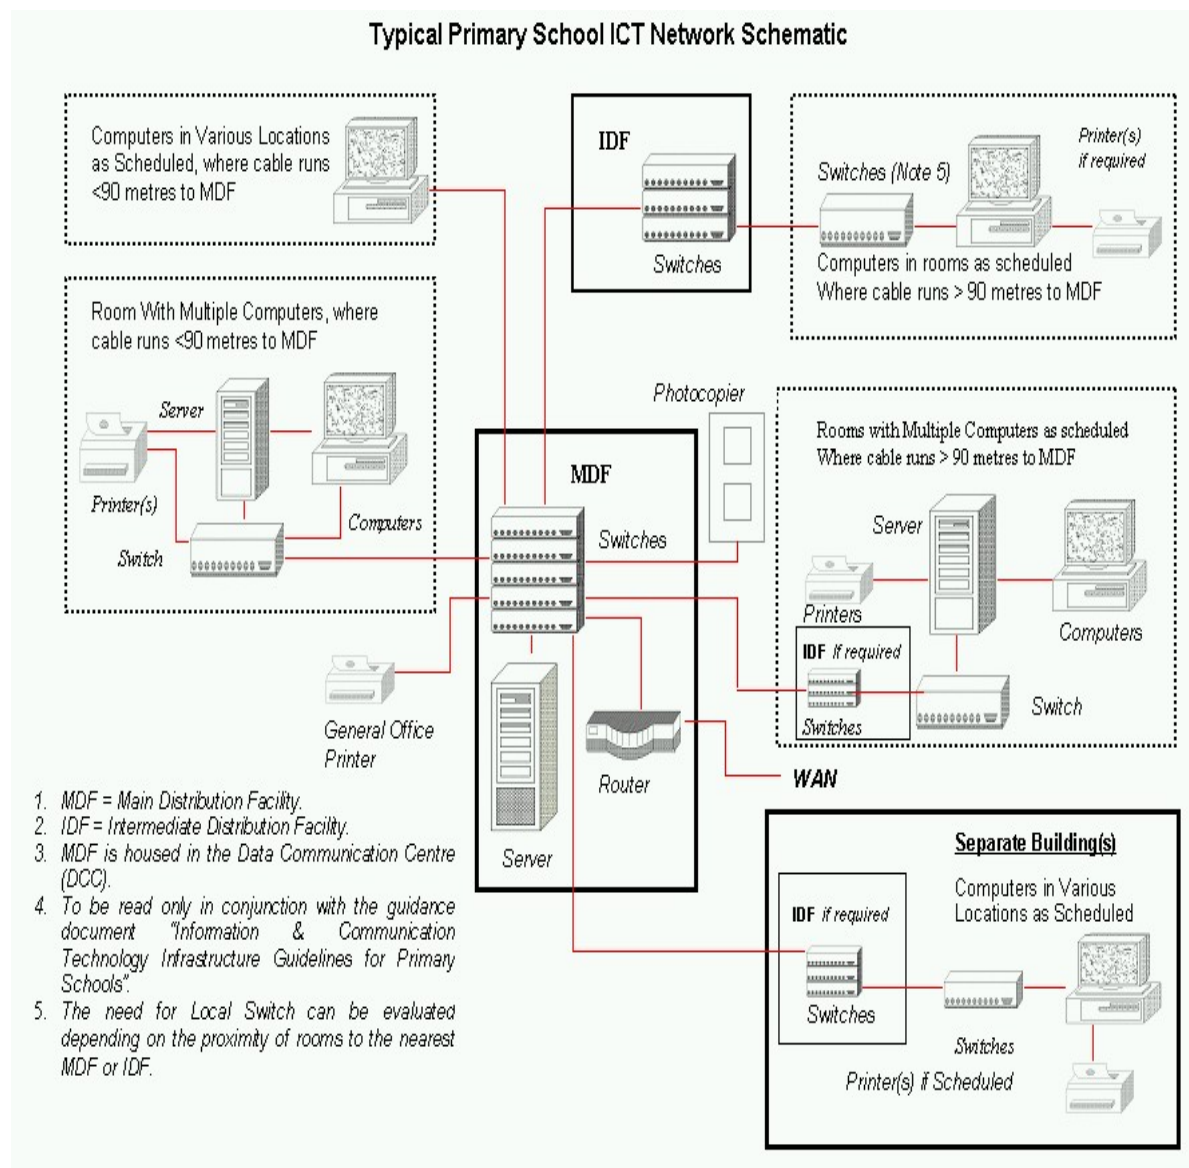



### **3.0 Communications Infrastructure**

This section details the communication infrastructure requirements.

#### **3.1 Data Communications Centre (DCC)**

A dedicated Data Communication Centre (DCC) shall be provided, size 2 m x 2 m x full ceiling height (min 2.7 m) and shall have no windows. This room shall house the Main Distribution Facility (MDF).

The DCC shall be suitably positioned off the circulation area or off a general store (subject to fire regulations) and be located in the main building. The room shall be fitted with a key operated lock as part of the master key suite of keys.

The DCC shall be naturally ventilated with air inlets at low level and air outlets at high-level opening to the corridor or to the store. Ventilation to the outside is generally not required.

The enclosure to this room should give a 30-minute fire rating; intumescent passive fire protection shall be used where necessary.

The location should, as far as practicable, be such that the cable run (actual cable length) to all network points is within the limit of 90 metres.

Only where this is not physically possible an Intermediate Distribution Facility (IDF) shall be provided as detailed below.

#### **3.2 Main Distribution Facility (MDF)**

The MDF shall be located in the DCC in lockable floor mounted equipment cabinets as detailed in section 4.3.4. It shall be supplied with patch panels.

The Client shall supply as part of the school's equipment, the router, servers and associated UPS, switches and patch leads in accordance with the Department's ICT Equipment Guidelines.

#### **3.3 Intermediate Distribution Facility (IDF)**

An Intermediate Distribution Facility (IDF) shall be provided where the cable run from the DCC to any Primary network point exceeds 90 metres or for each separate building.

The IDF will contain a lockable wall mounted equipment cabinet as detailed in section 4.3.4. It shall be supplied with patch panels.

The Client shall supply as part of the school's equipment, servers and associated UPS, switches and patch leads in accordance with the Department's ICT Equipment Guidelines.

The IDF shall be mounted at high level in a suitable position such as a store (not a teaching or habitable space). Ideally this space should not have a window but should be adequately ventilated to adjoining spaces.

The room housing the IDF shall be fitted with a key operated lock as part of the master key suite of keys.

#### **4.0 Services Infrastructure**

This section details the mechanical and electrical services associated with the ICT Infrastructure.

#### **4.1 Services to Primary Data Communications Equipment**

The following outlines the requirements for services to the primary data communication equipment.

##### **4.1.1 Data Communications Centre (DCC)**

A local electrical sub distribution board shall be provided in the DCC. The design capacity will need to be established on site but as a minimum a 35 A single-phase electrical supply shall be provided.

A small Uninterrupted Power supply unit shall be considered for the main server to back up the electronic equipment. This unit shall be supplied and installed as part of the Client supplied equipment.

Where 3 Phase power is available only one phase shall be used per room.

A dedicated earth from the main earth bar at the main LV switchboard shall be provided to the DCC to serve each of the data cabinets. The design capacity will need to be established on site.

A dedicated line (ExchL) from the telecommunications provider for Internet (WAN) connection shall be located in the room.

A fire extinguisher shall be provided of suitable class for electrical equipment.

A smoke detector shall be located in the room.

As automatic fire suppression system will not be provided to protect data or equipment, a local management system shall be put in place to protect important stored information.

##### **4.1.2 Main Distribution Facility (MDF)**

Power supply to each cabinet shall via a separate industrial type plug and socket to IS/EN 60309 from an MCB so as to eliminate the risk of nuisance

tripping. This shall be terminated in a switched spur, with a trailer lead directly connected and mounted in the cabinet.

Electrical Power Socket outlets shall be provided. The number of socket outlets can be calculated by dividing the number of network points by twenty-four. At least two additional socket outlets shall be provided for expansion.

Surge protection shall be considered at the input to the LV board. In new schools this shall be provided on the main incoming electrical supply to the school and will not be necessary at this board.

#### **4.1.3 Intermediate Distribution Facility (IDF)**

A local electrical sub distribution board shall be provided. The design capacity will need to be established on site but as a minimum a 35 A single-phase electrical supply shall be provided.

Power supply to each cabinet shall via a separate industrial type plug and socket to IS/EN 60309 from an MCB so as to eliminate the risk of nuisance tripping. This shall be terminated in a switched spur, with a trailer lead directly connected and mounted in the cabinet.

Electrical Power Socket outlets shall be provided. The number of socket outlets can be calculated by dividing the number of network points by twenty-four. At least two additional socket outlets shall be provided for expansion. A minimum of eight power outlets shall be provided.

A fire extinguisher shall be provided of suitable class for electrical equipment.

A smoke detector shall be located in the room.

#### **4.2 Services to Teaching Spaces**

The following outlines the requirements for services to the teaching rooms and habitable rooms where network points are scheduled.

All classrooms shall be networked with each room having five networked points connected via a local switch or directly to the MDF or IDF whichever is more economical.

Each specialist room shall have network points as scheduled connected via a local switch, or via the IDF to the MDF whichever is more economical.

The network points shall be located in one area of the room and positioned such that the equipment it serves will not have difficulty with glare and reflections on the screen. Where possible the computer area in adjoining classrooms should be positioned back to back such that the one vertical dado service drop can serve both rooms.

The position of new network points in existing schools shall be agreed with the school's management authority prior to design; positions of network points in new schools shall be as indicated on the standard room layout drawings.

Local distribution within the room shall be via three-compartment dado type trunking. The final position of the data and power outlets shall be above desk height. Sockets and fixings used on this trunking shall be of the range recommended for the trunking.

A fused spur (unswitched) shall be provided at high level for power supply to the local switch if the network design is based on this option.

Three number unswitched 13A sockets shall be allowed per computer station and one for a printer per room.

No more than five stations and one printer (sixteen sockets) shall be powered per RCD with appropriate MCB protection or whatever number of stations is recommended by respective manufacturers so as to eliminate the risk of nuisance tripping.

Lighting shall be of direct type as per "*Mechanical & Electrical Building Services Engineering Guidelines For Primary schools*".

### **4.3 General Structured Cabling Specification Requirements**

#### **4.3.1 Electromagnetic Compatibility (EMC) Compliance**

The EMC directive applies to requirements on emission and protection from electromagnetic interference in the EU.

EN 55022 and EN55105 are the standards applicable to Information Technology.

As the structured cabling system is a passive component, the EMC directive does not apply to the system, but to the final application. At time of writing, EMC test standards for links have not been finalised.

#### **4.3.2 Numbering and Labelling Scheme**

All links, cables, fibre optic or copper, shall be clearly labelled with a consistent numbering scheme. Radio, IR and Laser links shall be defined using the same numbering scheme.

In the following scheme;

"x" denotes a building number

"y" denotes an IDF; this shall be a letter.

"z" denotes an incremental number

It is suggested to label as per the following for MDF:

- a) Each MDF multimode fibre cable be marked as MDF MFz (MDF Multi Mode Fibre number "z")
- b) Each MDF single mode fibre cable be marked as MDF SFz (MDF Single Mode Fibre number "z")
- c) Each MDF balanced cable be marked as MDF BCz (MDF Balanced Cable number "z")

It is suggested to label as per the following for IDF:

- a) A number, "x" will describe each building.
- b) Each IDF multimode fibre cable be marked as IDF x MFz (IDF for building "x" Multi Mode Fibre number "z")
- c) Each IDF single mode fibre cable be marked as IDF x SFz (IDF for building "x" Single Mode Fibre number "z")

Each IDF balanced cable be marked as IDF x BCz (IDF for building "x" Balanced Cable number "z")

Each IDF CAT5e cable be marked as "xyz"; e.g. outlet number 64 from IDF distributor E in building 3 would be 3E64.

This numbering scheme shall be used to represent the wiring system when providing the client with interim and as-constructed drawings.

The following letter abbreviations may be used when describing links:

MDF	Main Distributor Facility
IDF	Intermediate Distributor Facility
MM	Multimode Fibre
SM	Single Mode Fibre
BC	Balanced Cable
RF	Radio Frequency link
IR	Infra Red link
LR	Laser Link

### 4.3.3 Point Density

The density of points shall be in accordance with the schedule in section 5.

### 4.3.4 Cabinets

Five types of cabinets are appropriate for general usage.

Type 1 shall be min. 39U, w. 600, d. 600. This is the smallest usable cabinet for general equipment.

Type 2 shall be min. 39U, w. 800, d. 600. This cabinet is for structured cabling where vertical cable management is required in the additional available 200 mm.

Type 3 shall be min. 39U, w. 600, d. 910. This extra depth is required for rack-mounted servers.

Type 4 shall be min. 39U, w. 800, d. 910. This cabinet is for all requirements in small schools (structured cabling, equipment, servers).

Type 5 shall be min 6U, w. 600, d. 400. This cabinet is a wall-mounted unit to house switches. These items shall be selected to suit cabinet size.

U = height unit = 44.5 mm

All cabinets shall be 19" rack mounting type of a solid and durable type. Frame shall be of min. 2 mm steel, doors and panels of min. 1.5 mm steel. Frame shall be seam-welded.

All floor-mounted cabinets shall be supplied with a plinth. Plinth shall have side openings in each direction.

Specified cabinets shall be suitable for computer room environments and shall conform to IP21 EN 60.529/IEC 529. Note that IP21 conformance is required on the installed cabinet after completion of installation. It is the installer's responsibility to ensure that sufficient care is taken during installation to achieve this.

Cabinets shall be supplied with lockable front doors with safety glazing. They may either be floor or wall mounted. Side and rear panels shall be of a steel construction and shall be removable. During installation, all adjacent cabinets shall be bolted together by the installer and only 2 side panels shall be required in total.

Cabinets shall be installed such that all equipment including patch panels may be serviced and installed from the front.

Cabinets shall be supplied with brush plates or other such entry mechanism to ensure that cable entries are tidy and sealed to IP21.

Suppliers shall declare conformance or otherwise with regard to the EU EMC directive relating to electromagnetic interference, on the completed installation, EU 89 / 363 with all amendments.

Cabinets shall be installed with full safety earthing.

All passive metallic components in the cabinet, when fully assembled with patch panels etc., shall be bonded to provide an adequate signal ground.

#### **4.3.5 Patch Panels**

Patch panels are required in all cases and shall be mounted in Type 2 cabinets.

Patch panels shall be 1U per row, with 24 x RJ45 type terminations per row.

Every second patch panel shall have a 2U horizontal cable management bracket mounted underneath. U = height unit = 44.5 mm.

Patch panels shall be fully accessible from the front.

#### **4.3.6 Sockets**

Sockets shall be of a single piece rugged construction. Modular socket assemblies will not be accepted. The supplier shall provide samples of sockets for approval.

For data sockets termination shall be on IDC style punch down connections to TSB-568-B.

#### **4.3.7 Warranty**

A fifteen-year warranty is required on the fibre optic cable installation and all other associated fibre optic components.

A link performance certificate for horizontal cabling is required, specifying that all such cables meet or exceed the requirements of ISO11801 Annex A.

A proprietary testing device shall be used to test the installation as recommended by the cabling manufacturers and approved by the Building Services Consulting Engineer.

#### **4.3.8 Horizontal Cables**

All cabling, connections and accessories in the structured cabling system shall conform fully with standard ISO/IEC 11801, EN50173, class D. tested to TSB67.

Cable shall be of a low smoke type and shall conform to building standards for plenum cables. Conformance or otherwise with standards IEC 332-1, 695-1, 754 and 1034 shall be requested.

Only three cable impedances are recognised by the standards; 100Ω, 120Ω and 150Ω; only 100Ω cables shall be used. Only UTP cable shall be used.

#### **4.3.9 Fibre Optic Cables**

Where Fibre Optic links are shown they shall consist of minimum four cores.

All external fibre shall be of loose tube type. All internal fibre shall be of tight

buffer type. All cores shall be terminated on each link.

In computer rooms or cabinets, fibre shall be terminated in 19" fibre patch panels in Type 1 cabinets. Sufficient socket space shall be left (eight per cable) to terminate all fibres, including those not yet terminated.

At other locations fibre shall be terminated in a sealed wall box, to IP21.

Sufficient socket space shall be left (eight per cable) to terminate all fibres, including those not yet terminated.

At any termination point proper splice trays shall be used for both terminated and un-terminated fibre. Proper laser hazard signage is to be provided at each end of the fibre termination.

All terminations shall be SC type. Cables shall be reinforced for resistance to mechanical stress.

#### **4.3.9.1 Internal Multimode Fibre Optic Cables**

62.5/125  $\mu$ M graded index cable shall be used. Step index fibre is not to be used. Cables shall be LSHF and water-resistant. Cables shall be metal free.

#### **4.3.9.2 External Multimode Fibre Optic Cables**

Where Primary schools comprise of more than one building it would be unusual for the buildings not to be relatively close to each other. In view of this 62.5/125  $\mu$ M graded index cable should be considered as first choice of application.

If a site has specific conditions that require a higher specification this should be referred to the Building Unit with recommendations on the most appropriate server solution. Step index fibre is not to be used. Cables shall be water resistant and metal free.

Outdoor splicing is to be avoided, except where cable breaks have occurred after handover.

### **4.4 General Specification Requirements**

#### **4.4.1 General Requirements**

All cableways (cable trays, trunking, conduit, wall boxes and Dado trunking where appropriate) shall be completely installed by the Electrical Contractor prior to the beginning of the structured cabling installation.

In general, cable trays shall be specified as wide and flat, rather than deep. In no case shall cables be laid more than six deep into a cableway.

No cableway shall be filled more than 60% after the initial installation.



Maximum loading for a cableway after upgrades and additions is 75%.

Gutter bolts shall be secured with the head inside and the nut outside.

For fibre optic cable, basket and tray are acceptable, it is not normally possible to guarantee the bend radius required for fibre in trunking. Conduit shall not be used for fibre optic cable, except for completely straight runs.

Carrier systems shall be bonded using flat-earth straps in accordance with current standards.

Where cable trays are used or vertical runs are required, cables shall be clipped to trays using loosely attached cable ties. Where cable ties are used to secure structured cables they shall be tied in bundles. Bundles shall be no greater than ten cables per bundle. Under no circumstances shall cables be tied tightly.

The shortest possible routes shall be used; drops and rises shall be minimised.

Power may not be run in the same compartment as structured cabling, under any circumstances.

Lift shafts shall not be used as routes for wiring.

Where crossovers exist, some cross-sectional area of cableways may be lost; this shall be accounted for when calculating the cable tray.

Where trunking or conduits pass through fire compartment walls, floors and ceilings, holes must be sealed with sealing compound giving appropriate rating of fire stability, to BS476 Part F.

#### **4.4.2 Socket Requirements**

The use of double adaptors to connect one or more computers or monitors to a single power outlet is not permitted. Each computer station application shall have power sockets as outlined earlier.

The final position of the data and power outlets shall be above desk height.

Sockets and fixings used on this trunking shall be of the range recommended for the trunking.

Where equipment shall be permanently plugged in and the plug will not be readily accessible then either a flush dual socket outlet without switches, or a flush single socket outlet without switches shall be specified.

In general where equipment shall be plugged into accessible sockets, either a flush dual socket outlet with outboard rocker switches and dual earth

terminals, or a flush single socket outlet with rocker switch and dual earth terminals shall be specified.

Sockets in specialist rooms shall be unswitched; sockets in general classrooms and offices shall be double pole switched type. These shall be specified on accompanying drawings. Separate sockets shall be provided for cleaner's usage.

#### **4.4.3 Electrical Distribution Boards**

All computer and equipment sockets shall be serviced using 20 A MCB/30mA RCD's for radial circuits.

No more than five stations and one printer (sixteen sockets) shall be powered per RCD with appropriate MCB protection or whatever number of stations is recommended by respective manufacturers so as to eliminate the risk of nuisance tripping.

All Data Communication Centres shall have a dedicated distribution panel.

#### **4.4.4 Main data cableways**

Many different cable tray types exist for use in data installations. Each has its own characteristics and benefits; each has its appropriate application. The consultant must establish compatibility between the cabling and the carrier system.

#### **4.4.5 Steel Trunking**

Steel trunking may be used for structured cabling in ceiling voids and in ducts, or for direct mounting of outlets in areas where additional durability is required (e.g. plant spaces and service areas).

#### **4.4.6 Floor Trunking**

Floor trunking and outlets shall be avoided in schools due to trip hazards and spillage over time from cleaning, etc.

#### **4.4.7 Cable Tray**

Galvanised cable tray is the most commonly used cableway for main runs and shall be adequately supported. As cables shall be run no more than six deep, cable trays shall be specified as wide and flat and no more than 50 mm deep.

#### **4.4.8 Baskets**

Baskets may be used for fibre optic cables, RF and audiovisual cables, but are not recommended for structured cabling (the mesh only makes contact with the cabling at points, potentially causing a pressure point on the cable).

#### **4.4.9 Compartment Trunking**

In all cases where dado trunking is being provided, care shall be taken to ensure that adequate clearance exists around the trunking for safe and easy insertion of power and data sockets. Co-ordination between furniture and electrical installer may be required.

To allow for flexibility three-compartment trunking shall be used in all areas. The bottom of the trunking shall be 150 mm above desk height. Sockets and fixings used on this trunking shall be of the range recommended for the trunking. For under-bench areas, or areas where aesthetic qualities are not critical, box trunking may be used.

Where power and up to fifteen data cables shall be run, 100x50 mm trunking may be used (assumes no socket box deeper than 35 mm).

Where power and up to thirty data cables shall be run 100x100 mm trunking with a cable divider may be used (assumes no socket box deeper than 35 mm), power and data cables must be kept separate by the divider, alternatively three compartment trunking may be used with two of the compartments used for data.

Where greater than thirty cables shall be run, separate trunking must be provided for power and data.

The Electrical Contractor as part of the infrastructure contract will provide RJ45 data sockets and patch panels for connection at local switches.

#### **4.4.10 Steel Conduit**

Steel conduit shall be used to drop to individual points and for AV usage. The exact depth of wall boxes must be agreed with the structured cabling installer prior to installation. This may be critical for the mechanical properties of some modular outlet systems.

With UTP cable on straight runs, it is possible to pass four UTP cables through 20 mm conduit and up to six UTP cables through 25 mm conduit. Cables shall be pulled in one operation; if cables are not pulled together, new cables being pulled through a conduit may damage existing cables.

For future LCD projector mounting points, where suspended ceilings are proposed, at least 2 x 25 mm conduits with draw wires shall be run to the projector position (power shall be run separately) from the teaching wall.

Plastic conduit is not recommended and should not be used. Conduit shall be secured every metre horizontally and every 1.2 m vertically. If there are no suspended ceilings and the design intent is that services are surface mounted then there is no need to make this provision.

Care shall be taken to remove all burrs and sharp edges; glands, grommets etc.

shall be used at ends of conduit to ensure no damage to cables.

Any conduit run shall have no more than two bends between inspection boxes and the bends shall not exceed the bend radius of the cable.

Conduit drops and runs shall be co-ordinated with locations of chalkboards, whiteboards, pin boards, etc.

## 5.0 Schedule of points

This section details the approved provision of points for the various rooms and areas in a school and the approved density. There shall be no deviation from the schedule.

<b>Local Area Network (LAN) Points</b>	
<b>Room</b>	<b>Number of network points</b>
General Classroom	5
Library & Resource Area	12
General Purpose Room	1
Multi Purpose Room	4
Learning Support Room	2
Home Liaison Room / Parents Room	2
Administration / General Office	1
Principal Office	1
Teachers room (up to 8 Classrooms)	1
Teachers room (> 8 Classrooms)	2
Plant room	1
Main Switchboard Area	1
Photocopier Area	1

## 6.0 Documentation

Specific areas of documentation shall be as outlined in these guidelines, general documentation shall be as detailed in the "*Mechanical & Electrical Building Services Engineering Guidelines For Primary schools*"

## 7.0 Testing, Commissioning and Record Drawings

All components must be guaranteed to Category 5e UTP Unscreened.

The performance of each link shall conform to ISO/IEC 11801: 2002 Class D and test set up and test equipment specification as per TSB 67 October 1995.

Test results shall be supplied to the Consultant and Client prior to acceptance of the installation. Results shall be supplied as a word file, in printed and electronic format.

Optical attenuation on all fibre optic links shall comply with ISO11801 section 7.3.1, table 10.

As a minimum the following results shall be provided per fibre optic cabling link, Connection Map, Length, Attenuation.

Horizontal cabling links shall be tested to TIA/EIA 568A Basic Link.

As a minimum the following results shall be provided in a link performance certificate per horizontal cabling link:

- Connection Map
- Length (or propagation delay)
- DC loop resistance/Pair
- Capacitance per pair
- Attenuation per pair (0-100MHZ)
- Near End Cross Talk NEXT per each pair combination (0-100MHZ)
- ACR per pair.

On completion, the supplier shall provide full test results in a bound paper form, and in an electronic format on disk and also provide 'as installed' drawings with floor plans, wire charts, cable paths, upgrade routes in AutoCAD 14 or latest edition as detailed above.

## **8.0 Training and Demonstration**

After the Building Services Consulting Engineer is satisfied and has witnessed that all equipment and systems are operating satisfactory, training and demonstration shall take place.

Adequate notice shall be given to the Client and, at an agreed time and in the presence of the Building Services Consulting Engineer, a training and demonstration event shall be provided.

### Appendix A Completion Record Sheet

<b>School Name:</b>		
<b>Address</b>		
<b>Project:</b>		
	<b>Signatures &amp; Date</b>	
<i>Information and Communication Technology Infrastructure, installed, tested and operating satisfactorily.</i>		
<i>Operating &amp; Maintenance Manuals handed over to School and explained.</i>		
<i>Training and demonstration meeting held in the presence of the Building Services Consulting Engineer and School Caretaker and Principal.</i>	<b>Date</b>	
<i>Wall Chart provided, explaining common operating / maintenance procedures.</i>		
<i>As installed Drawings handed over to school in hard copy and on disc.</i>		
<b>School Principal Name:</b>	<b>Signed:</b>	<b>Date:</b>
<b>Building Services Consulting Engineers Name:</b>	<b>Signed:</b>	<b>Date:</b>